

KCA Laboratories 232 North Plaza Drive

Nicholasville, KY 40356

+1-833-KCA-LABS https://kcalabs.com KDA Lic.# P_0058

Certificate of Analysis

4 of 5

CF7ABE305A

Sample ID: Batch: MFG Date: 10/24/24 Type: Finished Product - Ingestible

Matrix: Concentrate - Isolate


Unit Mass (g):

Collected: 10/31/2024 Received: 11/06/2024 Completed: 11/11/2024 Client

Microbials by PCR and Plating

Analyte	LOD (CFU/g)	Result (CFU/g)	Result (Qualitative)
Total aerobic count	10	ND	
Total coliforms	10	ND	
Generic E. coli	10	ND	
Salmonella spp.	1		Not Detected per 1 gram
Shiga-toxin producing E. coli (STEC)	1		Not Detected per 1 gram

ND = Not Detected; NT = Not Tested; LOD = Limit of Detection; LOQ = Limit of Quantitation; CFU = Colony Forming Units; P = Pass; F = Fail; RL = Reporting Limit

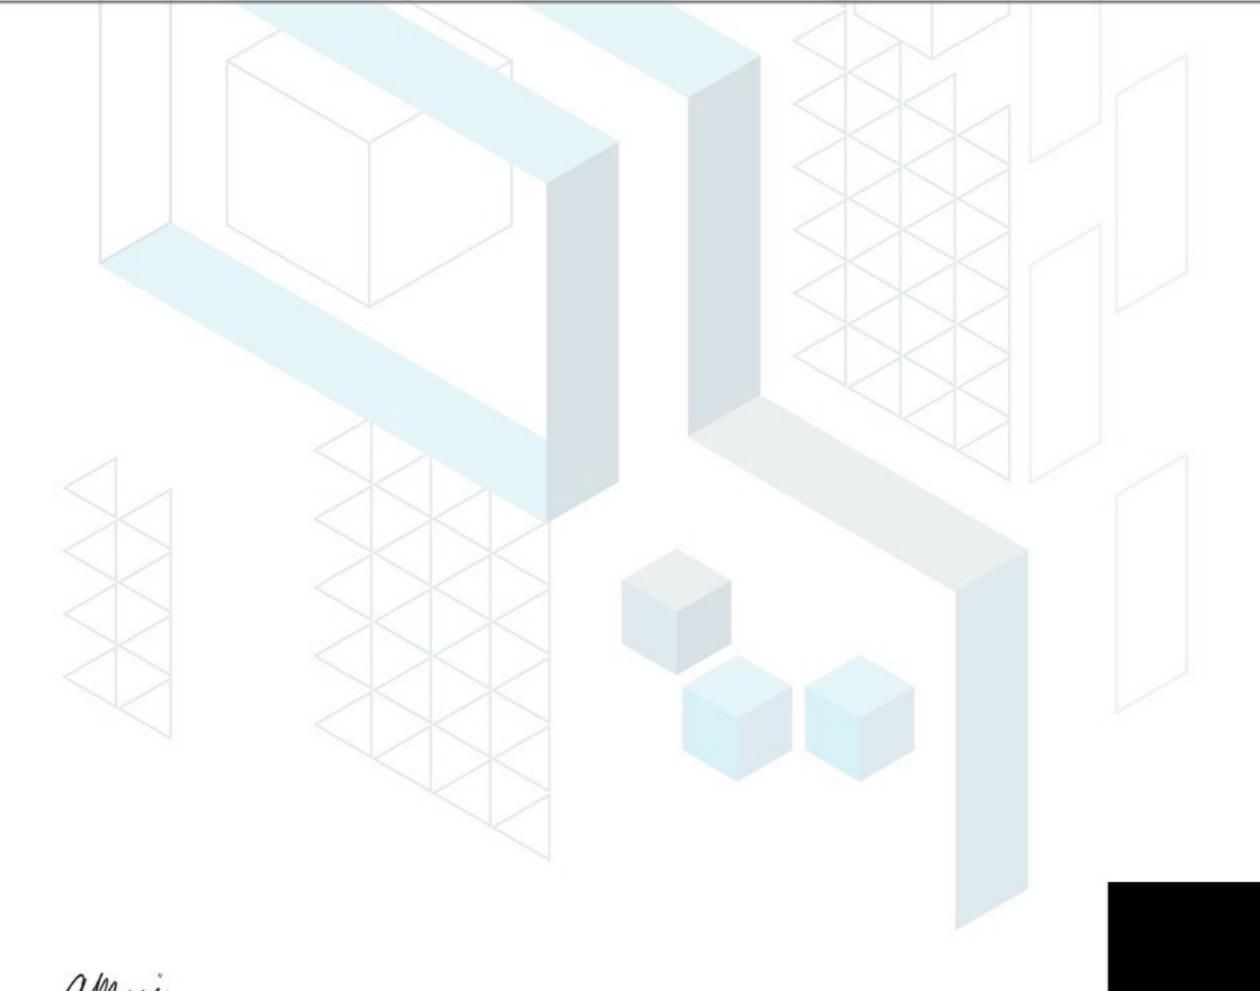

Generated By: Alex Morris
Quality Manager

Date: 11/11/2024

Tested By: Natalia Wright

Laboratory Technician Date: 11/10/2024